

CLASSIFICATION OF PROPERTIES

MLTB-1278-2014-IA

for Initial Type Testing (ITT) consistent with the norm PN-EN 14351-1+A1:2010
Assessment of the performance of the product on the basis of testing/ calculation




Notified body NB 2189

Company: **Przedsiębiorstwo Wielobranżowe "WITAL"**
Ryszard Tymofiejewicz
ul. Strefowa 7, 19-500 Gołdap

Product: single leaf window (1.23 x 2.18m) made from PVC profiles of system


Wital Prestige Therm

Test results are included in the following test reports registered under the number
of the request MLTB-1278-2014-IA



Testing methods:

Thermal permeability
PN-EN ISO 10077-1

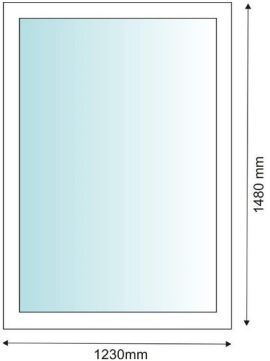Classification standards		PN-EN 14351-1 + A1:2010
Product type (B x H mm)		reference dimension 1230x1480 mm
		$U_f = 0.95 \text{ W/m}^2\text{K}$ $U_g = 0.5 \text{ W/m}^2\text{K}$ $\Psi_g = 0.059 \text{ W/mK}$ U_w 0.79 $\text{W/m}^2\text{K}$
Remarks: glass unit 4/18/4/18/4 $U_g = 0.5 \text{ W/m}^2\text{K}$ with aluminium spacer.		

Mobilne Laboratorium Techniki Budowlanej

assessment of the performance of the product
has been made by
calculation made by

kier. lab. Adam Mścichowski
st. technik Adam Domański

21-03-2014, Wałbrzych

Zgodnie z PN-EN 14351-1+A1:2010 pkt. 7.5 Stały nadzór i akceptacja FPC (ZKP) producent powinien wykonywać ocenę ZKP wraz z badaniami bieżącymi i badaniem kontrolnym gotowego wyrobu. Wykonywane kontrole zgodnie z planem badań potwierdzają te same właściwości dla produkowanych wyrobów co wyroby poddane badaniom wstępnym typu (ITT).



Mobilne Laboratorium Techniki
Budowlanej Sp. z o.o.
NIP PL 8862868350
REGON 020573602
KRS 0000461727

58-300 Wałbrzych, ul. Jana Kasprowicza 21 lok. 2
tel.: +48 74 840 14 63, fax: +48 74 661 41 40
<http://www.badaniaokien.pl>
e-mail: biuro@badaniaokien.pl

Notyfikowana jednostka
(notified body) NB 2189